


POM | KEPITAL F10-03H LOF | Grade

- KEPITAL F10-03H LOF (,) Grade .

- POM , .

		ISO 1043	-	POM
(23 , 50 %RH)		ISO 62	%	0.2
		ISO 1183	g/cm ³	1.41
		ISO 1133	g/10min	3.0
(1.8 MPa)		ISO 75		100
		UL 94	-	HB
		ISO 11359	X 10 ⁻⁵ /	12
		ISO 11357		170
		ISO 527	MPa	2,800
		ISO 527	MPa	67
		ISO 527	%	12
		ISO 527	%	35
		ISO 178	MPa	90
		ISO 178	MPa	2,600
Charpy	(Notched, 23)	ISO 179/1eA	kJ/m ²	8.5
Charpy	(Notched, -30)	ISO 179/1eA	kJ/m ²	6.5
		IEC 60093		1X10 ¹⁶
		IEC 60093	• cm	1X10 ¹⁴
		IEC 60243-1	kV/mm	19
(, t = 2 mm)		ISO 294-4	%	2.0

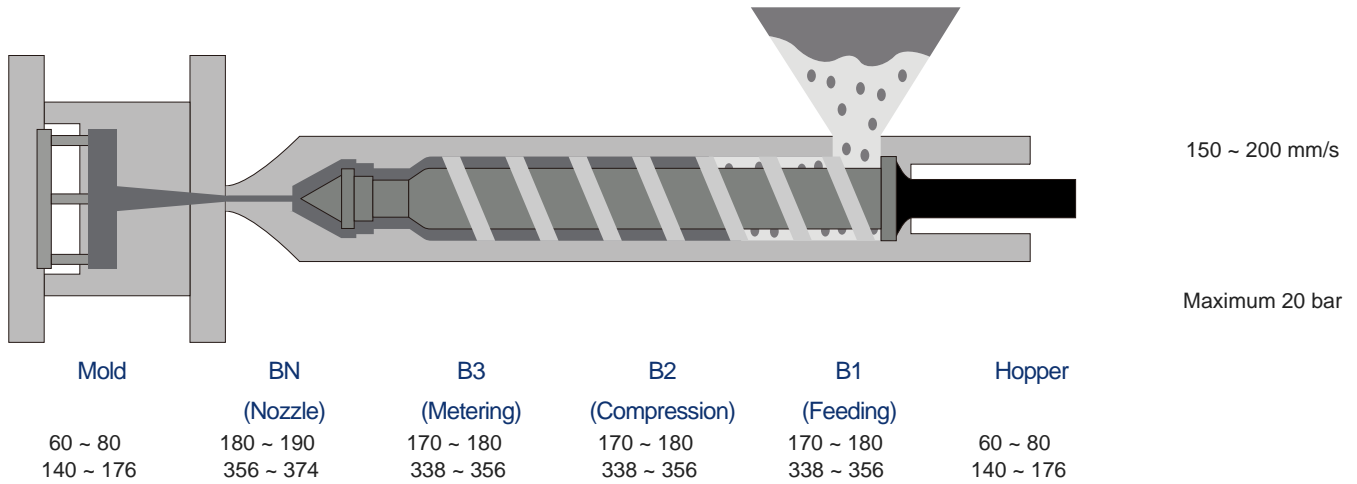

주소 : 230, T Tower 10 (04637) / Tel: 02-6952-8377
 연락처 : 94 (13901) / Tel: 031- 436 -1300

1. 가 가 () Implants
2. 가 가